

Ordering Information

Catalog No.	Diameter	Depth	Finish	Voltage/Ballast	Lamps
5004	15 3/8"	7 3/4"	Matte White	N/A	(3) A19 60W max.
5005WH226U			Matte White	120V / 277V Electronic	(2) 26W Quad Tube 4-Pin

Features

- Diffuser:** Blown white opal glass.
- Bracket:** Twist-lock fastening system, no tools required.
- Mounting Pan:** .050" min. thickness. Aluminum.
- Lamps:** Compact Fluorescent or Incandescent. (by others)
- Keyhole Mounting Slots:** For direct mounting to 4" octagonal outlet box.

Lamping

Incandescent: A19 60W max. (3)

Compact Fluorescent: 26W Quad tube (2)

	General Electric	Osram/Sylvania	Phillips
4-pin	F26 DBXT4/SPX*/4P	CF26DD/E/*	PL-C26W/*/4P

*Manufacturers' color temperature designation.

Electrical

Lampholders:

Incandescent: Medium base, porcelain, nickel-plate screw shell.

Compact Fluorescent: 4-pin, G24q-3 base



Electronic		
Ballast:	120V	277V
Total Input Watts	53	53
Max. Line Current (amps)	.46	.21
Power Factor	>.98	>.98
Ballast Factor	1.0	1.0
THD	<10%	<10%
Min. Starting Temps.	-20° C (-4°F)	-20° C (-4°F)

Labels


UL Listed, suitable for Damp Locations.

Job Information	Type:
Job Name:	
Cat. No.:	
Lamp(s):	
Notes:	

Lightolier a Genlyte Thomas Company
631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710
We reserve the right to change details of design, materials and finish.
© 2002 Genlyte Thomas Group LLC (Lightolier Division) • A0902

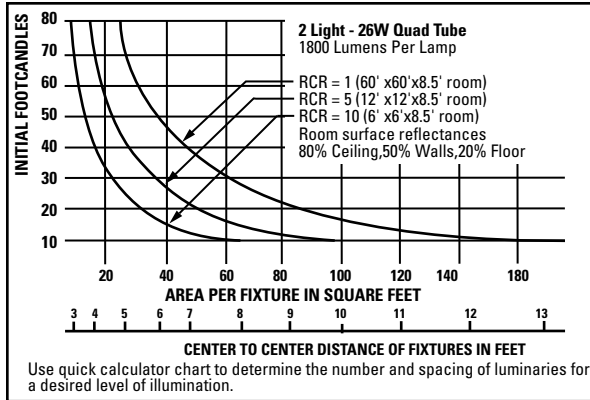

SPACING RATIO = 1.3

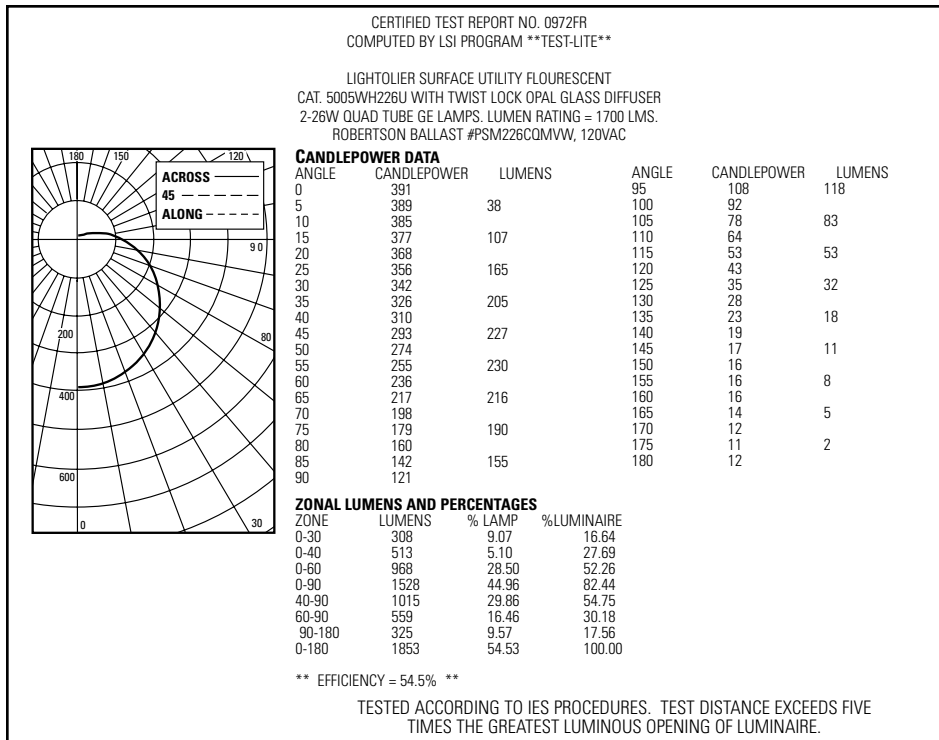

COEFFICIENTS OF UTILIZATION ZONAL CAVITY METHOD
%EFFECTIVE FLOOR CAVITY REFLECTANCE = .20

	80			70			50			30			10			
	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	
1	.52	.50	.47	.50	.48	.45	.46	.44	.42	.42	.41	.39	.39	.37	.36	.34
2	.45	.41	.37	.43	.39	.36	.40	.37	.34	.36	.34	.32	.33	.31	.30	.28
3	.39	.34	.30	.37	.33	.30	.35	.31	.28	.32	.29	.26	.29	.27	.24	.23
4	.35	.30	.26	.33	.29	.25	.31	.27	.24	.28	.25	.22	.26	.23	.21	.19
5	.31	.26	.22	.29	.25	.21	.27	.23	.20	.25	.22	.19	.23	.20	.18	.16
6	.27	.22	.19	.26	.22	.18	.24	.20	.17	.22	.19	.16	.21	.18	.15	.14
7	.24	.19	.16	.23	.19	.16	.22	.18	.15	.20	.17	.14	.19	.16	.13	.12
8	.22	.17	.14	.21	.17	.14	.20	.16	.13	.18	.15	.12	.17	.14	.12	.11
9	.20	.15	.12	.19	.15	.12	.18	.14	.11	.17	.13	.11	.15	.12	.10	.09
10	.18	.14	.11	.18	.13	.11	.16	.13	.10	.15	.12	.10	.14	.11	.09	.08

DETERMINED IN ACCORDANCE WITH CURRENT IES PUBLISHED PROCEDURES

Job Information**Type:**

Lightolier a Genlyte Thomas Company www.lightolier.com
631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710
We reserve the right to change details of design, materials and finish.
© 2002 Genlyte Thomas Group LLC (Lightolier Division) • A0902

LIGHTOLIER®